

October 2011

## Improvement of Transient Stability of VSC HVDC System with Particle Swarm Optimization Based PI Controller

N. Nayak

S.O.A University, niranjannayak.el.kec@gmail.com

S. K. Rout ray

High Tech Institute of Institute of Technology, skrout\_ray@gmail.com

P.K. Rout

S.O.A University, pkrou@gmail.com

Follow this and additional works at: <https://www.interscience.in/ijpsoem>



Part of the [Power and Energy Commons](#)

---

### Recommended Citation

Nayak, N.; Rout ray, S. K.; and Rout, P.K. (2011) "Improvement of Transient Stability of VSC HVDC System with Particle Swarm Optimization Based PI Controller," *International Journal of Power System Operation and Energy Management*. Vol. 1 : Iss. 2 , Article 2.

Available at: <https://www.interscience.in/ijpsoem/vol1/iss2/2>

This Article is brought to you for free and open access by Interscience Research Network. It has been accepted for inclusion in International Journal of Power System Operation and Energy Management by an authorized editor of Interscience Research Network. For more information, please contact [sritampatnaik@gmail.com](mailto:sritampatnaik@gmail.com).

# Improvement of Transient Stability of VSC HVDC System with Particle Swarm Optimization Based PI Controller

\*N. Nayak , \*\* S.K Rout ray, \*\*\* P.K. Rout

\*S.O.A University \*\* High Tech Institute of Institute of Technology, \*\*\* S.O.A University,  
niranjannayak.el.kec@gmail.com

*Abstracts : This paper proposes the improvement of power flow during transient condition of HVDC light using PI Controller. The Optimal design of PI controller for a HVDC light is a challenging task and time consuming using the conventional techniques. This work presents analysis of transient stability of HVDC link using PI controller, and the stability has been improved by optimized gains of PI controller. The simulation results are presented to show the effectiveness of the proposed Particle swarm Optimization Technique (PSO) based approach for the design of optimal conventional controller for a HVDC light in a single machine decoupled power system.*

*Index Terms: HDVC light, PSO, Transient Stability, PI controller*

## 1.Introduction

High voltage direct current (HVDC) transmission is an economic way for long distance bulk power delivery and/or interconnection of asynchronous system with different frequency [1]. HVDC system plays much more important role in power grids due to their huge capacity and capability of long distance transmission. Conventional HVDC transmission system is based on line commuted thyristor rectifiers [2]. Insulated gate bipolar transistor, (IGBT) is recently replaced by the conventional thyristor based HVDC link, due its fast controller action of GTO. Insulated-gate controlled Thyristers (IGCT) high power solid state switches have symmetrical turn on and turn off capabilities. They have given a new innovation of HVDC stations. HVDC light is also called voltage source convert HVDC or VSC HVDC [3].

The conventional HVDC scheme employ line commuted current source converter (CSC) based Thirsters. HVDC light is a new technology utilising forced commuted voltage source converters [4]. HVDC light can control both active and reactive power independently without commutation failure in the inverter side. It does not require reactive power compensator resulting much smaller equipment size. HVDC light can be applied to the voltage support in the receiver system [5]. It provides inter-connection between two asynchronous power systems [6], grid connection of large wind farm, [8] and undersea power transmission [9], Bidirectional power flow 12 HVDC light projects for different purposes already in operation worldwide.

For a single M/C power system connected to infinite bus the introduction of HVDC light can enhance the voltage support and improve the system stability. In this study problem of PI controller design to

formulated as a multi objective optimization problem.

section 1 represents the introduction part of thesis work and section 2 describes the fundamentals of HVDC system and VSC-HVDC system. It includes the construction operating principle and the type of HVDC links and their advantages and disadvantages along with its applications. section3 describes the particle swarm optimization technique (PSO) it describes the different parameters of PSO like velocity parameters, search technique etc. Section 4 describes the HVDC system under our study. It describes the mathematical modelling of synchronous generator, voltage sources converter (VSC), voltage source inverter (VSI) and the DC link. section 5 includes the simulation result and application of PSO to optimize the gains of PI controller used for HVDC light. It describes the quick response of PI controller with PSO and is compared with the results without PSO. section 6 contains conclusion of this work and at last section gives the bibliography and references of the present work.

## 2.Mathematical Modelling of Synchronous Machine

A power system can be modeled by a set of non-linear differential equations as

$$\frac{dX}{dt} = f(X, U) \quad (1)$$

Where X is the vector of the state variables and U is the vector of input variables. In this study, the fourth order model as given below is used for non-linear time domain simulation.

$$\frac{d\delta}{dt} = \omega - \omega_0 \quad (2)$$

$$\frac{d\omega}{dt} = (P_m - P_e)/M \quad (3)$$

$$\frac{dE_q}{dt} = (E_{fd} - (X_d - X_{dd}) I_d - E_q)/T_{do} \quad (4)$$

$$\frac{dE_{fd}}{dt} = (K_a(V_{ref} - V_t - V_{PSS}) - E_{fd})/T_a \quad (5)$$

Where

$\delta$  = Rotor angle

$\omega$  = Rotor speed

$P_m$  = Mechanical Power

$P_e$  = Electrical Power

$E_{fd}$  = Equivalent excitation voltage

d and q = direct and quadrature axes respectively

$E_q$  = Internal voltages behind the reactance  $X_d$  &  $X_q$

$T_a$  = Regulator time constant  
 $T_{do}$  = Time constant of excitation circuit  
 $K_a$  = Regulator gain

The d-q axis conversion of machine frame to network frame is expressed as following:

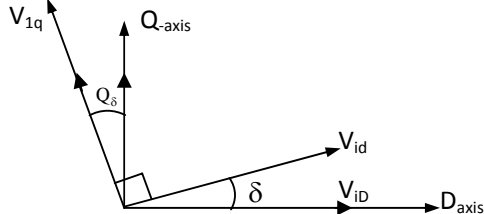


Fig.1.phasor diagram of network to machine conversion

Here  $V_{id}$  and  $V_{if}$  are the direct axis and quadrature axis voltage across the terminals in machine frame and  $V_{ID}$  and  $V_{IQ}$  are the terminal voltage in network frame.

$$V_{ID} = -V_{if} \sin \delta + V_{id} \cos \delta$$

$$V_{IQ} = V_{if} \cos \delta + V_{id} \sin \delta$$

In matrix form it can be written as

$$\begin{bmatrix} V_{ID} \\ V_{IQ} \end{bmatrix} = \begin{bmatrix} \cos \delta & -\sin \delta \\ \sin \delta & \cos \delta \end{bmatrix} \begin{bmatrix} V_{id} \\ V_{if} \end{bmatrix} \quad (6)$$

The machine terminal voltages

$$\left. \begin{aligned} V_{id} &= V_{ID} \cos \delta + V_{IQ} \sin \delta \\ V_{iq} &= -V_{ID} \sin \delta + V_{IQ} \cos \delta \end{aligned} \right\} \quad (7)$$

Similarly direct and quadrature axis current injected by the machine, is given by

$$\left. \begin{aligned} I_{id} &= I_{ID} \cos \delta + I_{IQ} \sin \delta \\ I_{iq} &= -I_{ID} \sin \delta + I_{IQ} \cos \delta \end{aligned} \right\} \quad (8)$$

Where, d, q represents machine frame

### 3. Modelling of vsc HVDC

HVDC light is composed of transformer filters, converters and D.C. capacitors. Transformer is used to step down the A.C. voltage to the converter rating value, and the self commuted solid state devices such as series and parallel of GTOS, IGBTs or IGCTs. High frequency components caused by the switches of the valves are isolated from power system, by filters. The heart of HVDC light is

converters which can realize the conversion from AC to DC bi-directionally. DC capacitors are used as DC voltage sources in HVDC light which need being charged and recharged.

Our analysis is based on a HVDC light used in a single m/c power system which is connected to infinite bus.

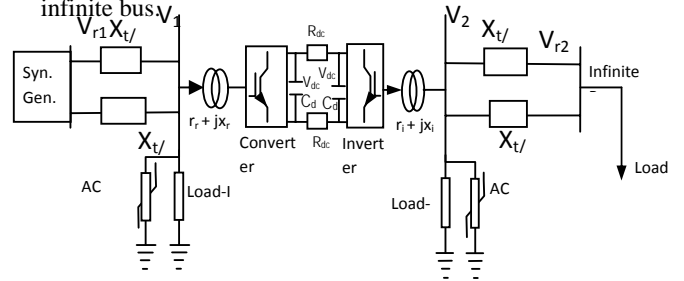


Fig.2.Model of decoupled VSC-HVDC with single machine connected to infinite bus

VSCI or Rectifier of HVDC light applies the active and reactive power control. But the VSC II i.e., inverter applies DC and AC voltage control. The active power is control by the phase angle of converter output voltage, and the reactive power is controlled by magnitude of converter voltage. In that sense active and reactive power controlled independently.

The rectifier controller is shown in the fig.(4). The controller consists of four parts. Power flow control loop, reactive power flow loop, phase locked loop (PLL) and PWM pulse firing.

A typical VSC HVDC transmission link consists of two converter stations one station operates as rectifier and other one operates as inverter station as shown in the fig.3. The mathematical model developed in this paper depends on a rotating d.q frame. transform RYB to D Q frame. With the increasing the application of voltage source converter.,

The dynamic equations of rectifier and inverter in the rotating d-f frame can be written as follows:

#### 3.1.Rectifier

$$\dot{I}_r D = -\frac{(r_r \cdot I_D)}{L_r} + \omega_1 I_{rQ} + \frac{V_{ID}}{L_r} - \frac{V_{rD}}{L_r} \quad (1)$$

$$I_{dc} = I_{dc1} - \frac{V_{ldc1}}{R_{sh1}} \quad (2)$$

$$\dot{I}_{rQ} = -\frac{(r_r \cdot I_{rQ})}{L_r} - \omega_1 I_{rD} + \frac{V_{IQ}}{L_r} - \frac{V_{rQ}}{L_r} \quad (3)$$

$$V_{dc1} = \frac{P_{dc1}}{(V_{dc1} C_{dc})} - \frac{I_{dc}}{C_{dc}} \quad (4)$$

### 3.2. Inverter:

$$\dot{I}_{iD} = \frac{-r_i I_{iD}}{L_i} + \omega_2 I_r Q - \frac{V_{2D}}{L_r} + \frac{V_{iD}}{L_i} \quad (5)$$

$$\dot{I}_{iQ} = \frac{-r_i I_{iQ}}{L_i} - \omega_2 I_{iD} - \frac{V_{2Q}}{L_i} + \frac{V_{iQ}}{L_i} \quad (6)$$

$$\dot{V}_{dc2} = \frac{I_{dc}}{C_{dc}} - \frac{I_{dc}}{C_{dc} V_{dc}} \quad (7)$$

$$I_{dc2} = I_{dc} - \frac{V_{dc2}}{R_{sh2}}$$

Where  $I_{iD}$ ,  $I_{iQ}$ ,  $V_{iD}$ ,  $V_{iQ}$  are d-f axis currents of rectifier side, and  $I_r$ ,  $I_Q$ ,  $V_{2D}$  and  $V_{2Q}$  are the d-f axis current and voltages of inverter side.  $r_r + jx_r$  and  $r_i + jx_i$  are the complex impedance of rectifier and inverter respectively.  $L_r$  and  $L_i$  are the inductance of smoothing reactors used in converter and inverter respectively.  $V_{dc1}$ ,  $V_{dc2}$  and  $I_{dc}$  are the d.c. link voltage and current.  $C_{dc}$  is the capacitor of the d.c. link,  $R_{sh1}$  and  $R_{sh2}$  are the shunt resistances of the HVDC system.

The switching frequency of the rectifier is 2050 Hz where as the switching frequency of the inverter station is 2460 Hz making  $V_{rD}$  and  $V_{rQ}$  are the control input to the rectifier  $V_{iD}$  and  $V_{iQ}$  to the inverter, Expanding the  $P_{dc1}$  in (3) the system equation can be written as

$$\dot{I}_{rD} = \frac{(r_r I_{rD})}{L_r} + \omega_1 I_{rQ} + \frac{V_{iD}}{L_r} - \frac{u_1}{L_r} \quad (8)$$

$$\dot{I}_{rQ} = \frac{(r_r I_{rQ})}{L_r} - \omega_1 I_{rD} + \frac{V_{iQ}}{L_r} - \frac{u_2}{L_r} \quad (9)$$

$$\dot{V}_{dc1} = \left\{ (V_{iD} I_{rD} + V_{iQ} I_{rQ}) - r_r (I_{rD}^2 + I_{rQ}^2) \right\} - \frac{(V_{dc1} - V_{dc2})}{R_{dc} C_{dc}}$$

$$\dot{I}_{iD} = \frac{r_i I_{iD}}{L_i} + \omega_2 I_{iQ} - \frac{V_{2D}}{L_r} + \frac{u_3}{L_i} \quad (10)$$

$$\dot{I}_{iQ} = -\frac{r_i I_{iQ}}{L_i} - \omega_2 I_{iD} - \frac{V_{2Q}}{L_i} + \frac{u_4}{L_i} \quad (10)$$

## 4. Particle Swarm Optimization

Particle Swarm Optimization (PSO), one of the latest metaheuristic algorithms, was first introduced by Kennedy and Eberhart 1995. PSO is based on the metaphor of social interaction and communication such as bird flocking and fish schooling. Since PSO is population based and socially cognitive in nature, the members in a swarm tend to follow the leader of the group, i.e., the one with the best performance. In a PSO algorithm, each member is called a "particle", and each particle flies around in the multi-dimensional search space with a velocity, which is updated according to the particle's current velocity, the particle's own experience and the experience of the neighbors. Depending on the size of neighbors, two types of basic PSO algorithms were developed- PSO with a local neighborhood and PSO with global neighborhood of Kennedy et al. 2001. In the former model, called the *lbest*, each particle moves towards its best previous position and towards the best particle in its restricted neighborhood. While in the latter model, called the *gbest*, each particle moves towards its best previous position and towards the best particle in the entire swarm.

PSO was first developed to optimize continuous nonlinear functions. Since PSO is easy to implement and is efficient to obtain quality solutions, it has attracted much researchers' attention in recent years. The application of PSO consists of neural network training, power and voltage control, optimal power system design, feature selection, mass-spring system, electromagnetic, clustering, logic circuit design, lot sizing problem, task assignment problem, automated drilling, and scheduling problems. More literature can be found in the reference of Kennedy et al. 2001. Besides the wide range of applications above, the nonlinear continuous function optimization is still considered the benchmark problem when exploring the properties and performance of PSO algorithms. Therefore, this paper aims at employing PSO on optimizing 14 newly developed test problems in Congress on Evolutionary Computation 2005.

### 4.1. PSO Algorithm

The *gbest* model of Kennedy et al. 2001 is followed in this study. According to the *gbest* model, each particle moves towards its best previous position and towards the best particle in the whole swarm. In the PSO algorithm, parameters were initialized and the initial population was generated randomly. Each particle will then be evaluated to compute the fitness function value. After evaluation, the PSO algorithm repeats the following steps iteratively.

With its position, velocity and fitness value, each particle updates its personal best (best value of each individual so far) if an improved fitness value was found.

The basic elements of PSO algorithm is summarized as follows:

**Particle**

$X_i^t$  denotes the  $i^{\text{th}}$  particle in the swarm at iteration  $t$  and is represented by  $n$  numbers of dimensions as  $X_i^t = [x_{i1}^t, x_{i2}^t, \dots, x_{in}^t]$  where  $x_{ij}^t$  is the position value of the  $i^{\text{th}}$  particle with respect to the  $j^{\text{th}}$  dimension ( $j = 1, 2, \dots, n$ ).

**Population**

$X^t$  is the set of NP particles in the swarm at iteration  $t$ , i.e.,

$$X^t = [X_1^t, X_2^t, \dots, X_{NP}^t]. \tag{11}$$

**Particle Velocity**

$V_i^t$  is the velocity of particle  $I$  at iteration  $t$ . It can be defined as  $V_i^t = [v_{i1}^t, v_{i2}^t, \dots, v_{in}^t]$ ,

$$\tag{12}$$

where  $v_{ij}^t$  is the velocity of particle  $I$  at iteration  $t$  with respect to the  $j^{\text{th}}$  dimension.

**Inertia weight and acceleration co-efficients**

$w^t$  is a parameter to control the impact of the previous velocities on the current velocity. It has an impact on the trade-off between the global and local exploration capabilities of the particle. At the beginning of the search, large inertia weight is used to enhance the global exploration while it is reduced for better local exploitation later on in the search.  $c_1$  and  $c_2$  are constant parameters called acceleration coefficient which control the maximum step size that the particle can do.

**Personal best**

$P_i^t$  represents the best position of the particle with the best fitness value until iteration  $t$ , so the best position associated with the best fitness value of the particle obtained so far is called the *personal best*.

For each particle in the swarm,  $P_i^t$  can be determined and updated at each iteration  $t$ . In a minimization problem with the objective function  $f(X_i^t)$ , the personal best  $P_i^t$  of the  $i^{\text{th}}$  particle is obtained such that  $f(P_i^t) \leq f(P_i^{t-1})$ . To simplify, the fitness function of the personal best is denoted as  $f_i^{pb} = f(P_i^t)$ . For each particle, the personal best is defined as  $P_i^t = [p_{i1}^t, p_{i2}^t, \dots, p_{in}^t]$  where

$p_{ij}^t$  is the position value of the  $i^{\text{th}}$  personal best with respect to the  $j^{\text{th}}$  dimension ( $j = 1, 2, \dots, n$ ).

**Global Best**

$G^t$  denotes the best position of the globally best particle achieved so far in the whole swarm. For this reason, the global best can be obtained such that  $f(G^t) \leq f(P_i^t)$  for  $I = 1, 2, \dots, NP$ . To simplify,

the fitness function of the global best is denoted as  $f^{gb} = f(G^t)$ . The global best is then defined as

$G^t = [g_1^t, g_2^t, \dots, g_n^t]$  where  $g_j^t$  is the position value of the global best with respect to the  $j^{\text{th}}$  dimension ( $j = 1, 2, \dots, n$ ).

**Termination Criterion**

It is a condition that terminates the search process. It might be a maximum number of function evaluations or a maximum CPU time that terminates the search.

**3.3 Initial Population**

A population of particles is constructed randomly for the PSO algorithm. The continuous values of positions are established randomly. The following formula is used to construct the initial continuous position values of the particle uniformly:

$$x_{ij}^0 = x_{\min} + (x_{\max} - x_{\min}) * r_1 \tag{13}$$

Where  $x_{\max}$  and  $x_{\min}$  are given bounds of the continuous functions and  $r_1$  is a uniform random number between 0 and 1. Initial velocities are generated by a similar formula as follows:

$$v_{ij}^0 = v_{\min} + (v_{\max} - v_{\min}) * r_2 \tag{14}$$

where  $v_{\max} = (x_{\max} - x_{\min}) / 2$  and  $v_{\min} = -v_{\max}$ , and  $r_2$  is a uniform random number between 0 and 1. Continuous velocity values are restricted to some range, namely

$$v_{ij}^t = [v_{\min}, v_{\max}]$$

During the reproduction of the PSO algorithm, it is possible to extend the search outside of the initial range of the search space. For this reason, the position values violating the initial range are restricted to the feasible range as follows:

$$x_{ij}^t = x_{\min} + (x_{\max} - x_{\min}) * r_1 \tag{15}$$

The only exception was the problem 7 for which the optimal was not inside the search limits. The population size is taken as 100. As the formulation of 14 functions suggests that the objective is to minimize 14 continuous functions, the fitness function value is the objective function value of the particle  $X^t$ . That is  $f_i^t(X_i^t)$ . For simplicity,  $f_i^t(X_i^t)$  will be denoted as  $f_i^t$ .

**4.2. Computational Procedure of PSO**

The complete computational procedure of the PSO algorithm can be summarized as follows:

**Initialization**

Set  $t = 0$ , NP = 100

Generate NP particles randomly as explained before,  $\{X_i^0, i = 1, 2, \dots, NP\}$  where

$$X_i^0 = [x_{i1}^0, x_{i2}^0, \dots, x_{in}^0]$$

Generate the initial velocities for each particle randomly.  $\{V_i^0, i = 1, 2, \dots, NP\}$  where

$$V_i^0 = [v_{i1}^0, v_{i2}^0, \dots, v_{in}^0]$$

Evaluate each particle in the swarm using the objective function  $f_i^0$  for  $I = 1, 2, \dots, NP$ .

For each particle in the swarm, set  $P_i^0 = X_i^0$ , where

$$P_i^0 = [p_{i1}^0 = x_{i1}^0, p_{i2}^0 = x_{i2}^0, \dots, p_{in}^0 = x_{in}^0]$$

together with its best fitness value  $f_i^{pb}$  for  $I = 1, 2, \dots, NP$ .

First the best fitness value among the whole swarm such that  $f_i = \min\{f_i^0\}$  for  $I = 1, 2, \dots, NP$  with

its corresponding positions  $X_1^0$ . Set global best to  $G^0 = X_1^0$  such that

$$G^0 = [g_1 = x_{i1}, g_2 = x_{i2}, \dots, g_n = x_{in}]$$

with its fitness value  $f^{gb} = f_1$ .

**Update iteration counter**

$t = t + 1$

**Update inertia weight**

$$w^t = ((\max\_fes - FES) / \max\_fes) * (w_0 - w_n) + w_n$$

where  $\max\_fes$ ,  $FES$ ,  $w_0$ , and  $w_n$  are the maximum number of function evaluation, number of function evaluations, initial inertia weight, and final inertia weight respectively.

**Update velocity**

$$v_{ij}^t = w^{t-1} v_{ij}^{t-1} + c_1 r_1 (p_{ij}^{t-1} - x_{ij}^{t-1}) + c_2 r_2 (g_j^{t-1} - x_{ij}^{t-1})$$

where  $c_1$  and  $c_2$  are acceleration coefficients and  $r_1$  and  $r_2$  are uniform random numbers between (0, 1).

**Update Position**

$$x_{ij}^t = x_{ij}^{t-1} + v_{ij}^t$$

**Update personal best**

Each particle is evaluated by using the permutation to see if the personal best will improve. That is, if

$f_i^t < f_i^{pb}$  for  $I = 1, 2, \dots, NP$  then personal best is updated as  $P_i^t = X_i^t$  for  $f_i^{pb} = f_i^t$ .

**Update global best**

Find the minimum value of personal best. That is,  $f_1^t = \min\{f_i^{pb}\}$ ,  $I = 1, 2, \dots, NP$ ;  $l \in \{i : i = 1, 2, \dots, NP\}$ .

If  $f_i^t < f^{gb}$ , then the global best is updated as  $G^t = X_l^t$  and  $f^{gb} = f_l^t$

**Stopping criterion**

If the number of function evaluations exceeds the maximum number of function evaluations, that stop; otherwise go to step 2.

**5. PI Controller**

The State variables of rectifier station are  $I_{rd}$ ,  $I_{rq}$  and  $V_{dc1}$  for convinnance dc voltage and reactive power of the rectifier are taken as the output variables. Since the reference bus d-axis voltage is taken as zero the reactive power directly controlled by  $I_{rd}$ .

The State variables of inverter station are  $I_{id}$ ,  $I_{iq}$  and  $V_{id}$  and  $V_{iq}$ . Since the inverter station is operating in the active and reactive control mode the output states are  $I_{id}$ ,  $I_{iq}$ . As the reference bus in the inverter side is chosen as one the d-axis current represent reactive power whereas q-axis current represents the active power flow in the inverter station, the whole PI controller strategy is describe by the following diagram. In the figure 4.3.

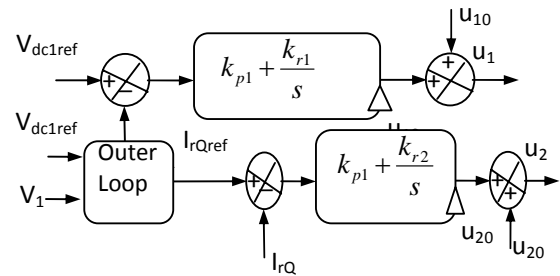


Fig.3. PI controller for rectifier station

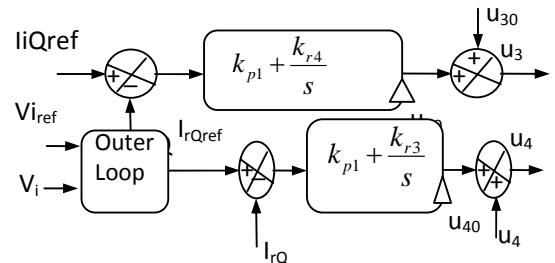


Fig.4.PI controller for inverter station







Table-5.1

	Converter Controller gain				Inverter gain			
	Kp1	Kp2	Kp3	Kp4	Ki1	Ki2	Ki3	Ki4
Conventional PI	0.2	0.2	0.3	0.2	-	0.2	0.1	0.1
With PSO	0.1	0.2	0.1	0.1	-	0.2	0.2	0.05
	4	9	1	3	0.23	8	2	

### 6.Simulation Result

In this paper the conventional PI controller has been simulated in MATLAB. The performance of PI controller is tested under various conditions with normal gains. The result is compared with the performance with optimized gains of PI controller used PSO .

**Case 1:** Here during a LLLG fault at bus 1 from 1s to 1.2 sec. Due to the fault the a.c. voltage, has decreased to a critical value.In Fig(4) it is shown the improvement of damping of  $V_{dc1}$  and the performance of the PSO based PI controller restores the system than the earlier conventional PI controller., in bus 1, rectifier output and respective reactive power with normal PI controller and the result is compared with performance with optimized PI controller . Due to decoupling effect the active and reactive power , the rectifier station does not change at inverter station fault as shown

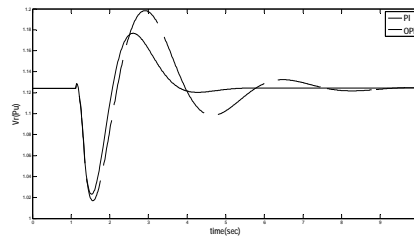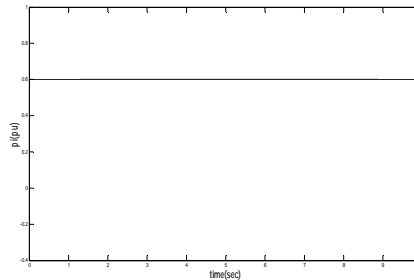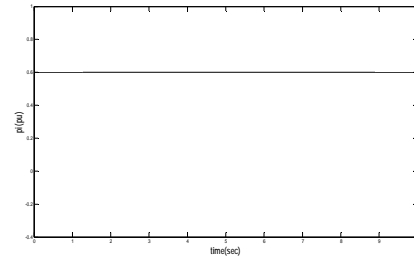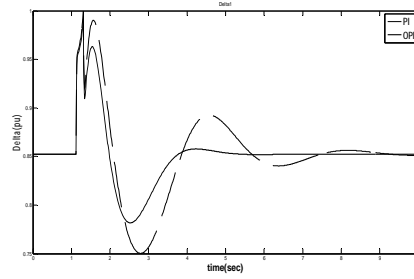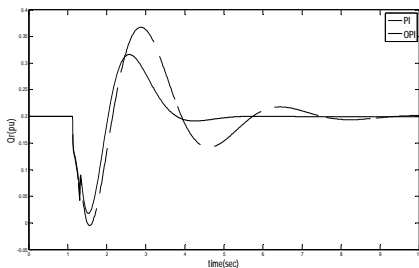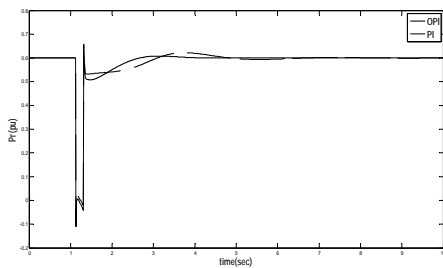

**Fig.5. Performance comparison of the controller under resistance fault at bus1**

**Case 2:** Here a 1 cycle LLLG fault at bus 2 with same earthing operating condition is simulated on the inverter side, Fig. 5shows the satisfactory improvement of damping in , active and reactive power, power angle, rotor angular velocity in both rectifiers and inverter side, With deferential evolution based PI controller. Due to decoupling effect the active and reactive power of rectifier station does not change at inverter station fault








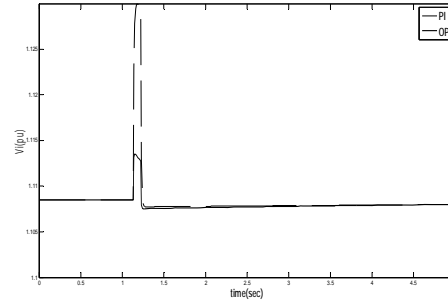


Fig.5. Performance comparison of the controller under resistance fault bus2

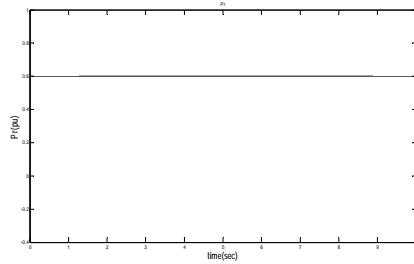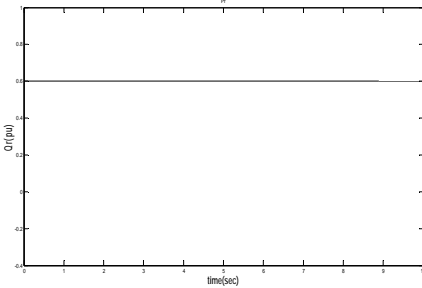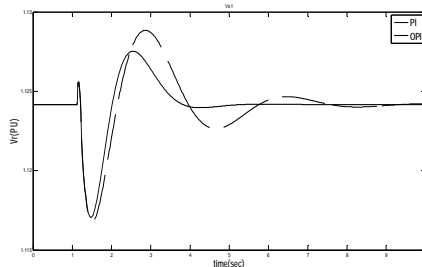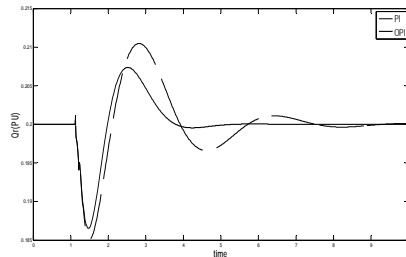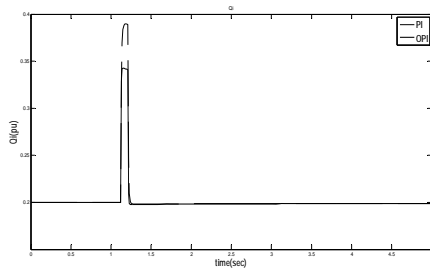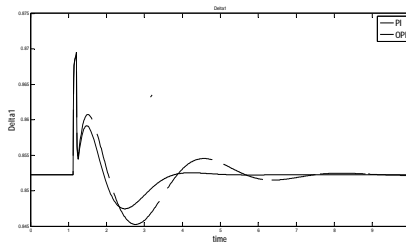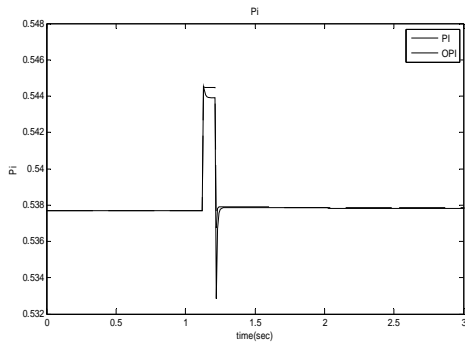

**Case 3:**

Here a 1 cycle fault at bus 2 is created by increasing the load in the inverter side(20 percent of the original value) with same earthing operating condition is simulated on the inverter side, Fig. 6 shows the satisfactory improvement of damping in , active and reactive power, power angle, rotor angular velocity in both rectifiers and inverter side, With PSO based PI controller.





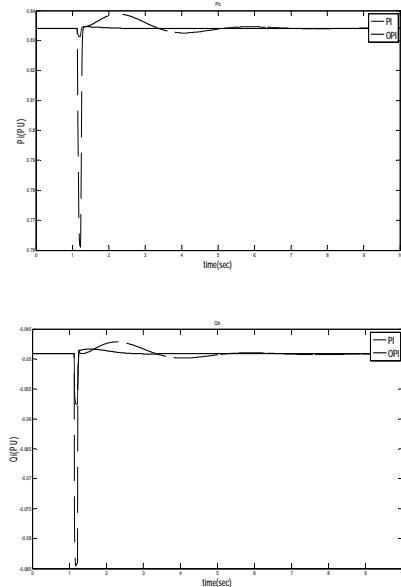


Fig.6. Performance comparison of the controller under load fault at bus2

### 7. Conclusion

In this paper transient stability performance of VSC-HVDC is improved by a PI controller is investigated. The gains of PI controllers for rectifier and inverter are optimized by use of Particle swarm optimization technique. The effectiveness of the proposed HVDC controller for improving transient stability are demonstrated by a decoupled power system with VSC-HVDC subjected to different severe disturbances. In all the cases it is realized that the PSO based PI controller stabilize the system quicker than the conventional PI controller.

### 8. Appendix

Base voltage = 132 KV(a.c.) 150 V<sub>dc</sub>  
 Pass power = 100MVA  
 Initial Operating Point 60 MW and 10 MVAR  
 Load 1 : (Converter side)  
 3 MW and 2 MVAR  
 $R_1 = 0.02H$   
 Load 2 : (Inverter side)  
 30 MW and 20 MVAR  
 $R_2 = 10,000\Omega$   
 $L_2 = 0.02H$   
 Transmission Line Parameter  
 $x_{t11} = x_{t22} = 0.05\Omega / km$  (25 Km)  
 d.c. transmission line resistance  
 $R_{dc} = 0.01\Omega / km$  (50 Km)  
 Shunt resistance  $R_{sh1} = R_{sh2} = 10000\Omega$   
 Converter Station  
 $r_r = 1.452\Omega$ ,  $r_i = 1.452\Omega$

$$x_r = 2.9\Omega, x_i = 2.9\Omega$$

D.c. link capacitor  $C_{dc} = 5000\mu F$

a.c. filter capacitor =  $10\mu F$ .

### 9. References

1. B.R. Andersen, L. Xu, P.J. Horton, P. Cartwright. *Topologies for HVDC VSC Transmission*. IEEE Power Engineering Journal, June, 2006: 142-150.
2. Mao Xiao-ming; Zhang Hao; Guan Lin; Wu Xiao-chen. *Coordinated control of inter area oscillation in the China Southern power grid (J)*. IEEE Trans. On Power Systems, 2006, 21(2): 845-852.
3. P. Kundur. *Power System Stability and Control*. McGraw-Hill, Companies, Inc, New York, 1994.
4. Z Zhao, M.R. Irvani. *Application of GTO Voltage Source Inverter in a Hybrid HVDC Link*. IEEE Trans. On Power Delivery, 1994, 9(1): 369-377.
5. D.N. Kosterev. *Modeling Synchronous Voltage Source Converters in Transmission System Planning Studies*. IEEE Trans. On Power Delivery, 1997, 12(2); 947-952.
6. Z. Huang. B.T. Ooi, L.-A Dessaint, F.D. Galiana. *Exploiting Voltage Support of Voltage-Source HVDC*. IEE Proc. Gener. Transm. Distrib., 2003, 150(2): 252-256.
7. B.-M. Han, S.-T. Baek, B.-Y. Bae, J.-Y. Choi. *Back-to-back HVDC system using a 36-step voltage source converter*. IEE Proc.-Gener. Transm. Distrib., 2006, 153(6): 677-673.
8. Lie Xu, Liangzhong Yao, Christian Sasse. *Grid Integration of Large DFIG- Based Wind Farms using VSC Transmission*. IEEE Trans. On Power Systems, 2007,22(3): 976-984.
9. Paola Bresesti, Wil L. Kling, Ralph L. Hendriks, Riccardo Vailati. *HVDC Connection of Offshore Wind Farms to the Transmission System*. IEEE Trans. On Energy Conversion, 2007, 22(1): 37-43.
10. Chang Hsin Chien, Richard W.G. Bucknall. *Analysis of Harmonics in Subsea Power Transmission Cables Used in VSC-HVDC Transmission Systems Operating Under Steady-State Conditions*. IEEE Trans. On Power Delivery, 2007, 22(4): 2489-2497.
11. A. Tuson, and P. Ross, "Adapting operator settings in genetic algorithms," *Evolut. Comput.*, vol. No.2, pp. 161-184, 1998.
12. J. Gomez, D. Dasgupta, and F. Gonzalez, "Using adaptive operators in genetic search," in *Proc. Genetic Evolut. Comput. Conf.*, Chicago, IL, Jul. 2003, pp. 1580-1581.
13. B.R. Julstrom, "What have you done for me lately? Adapting operator probabilities in a steady-state genetic Algorithms, Pittsburgh, PA, Jul. 15-19, 1995, pp. 81-87.
14. P.J. Angline, "Adaptive and self-adaptive evolutionary computation," in *Computational Intelligence: Adynamic System Perspective*, M. Palaniswami, Y. Attkiouzel, R.J. Marks, D. Fogel, and T. Fukuda, Eds. New York, IEEE Press, 1995, pp.152-161.
15. J.E. Smith and T.C. Fogarty, "Operator and parameter adaptation in genetic algorithms," *Soft Comput*, vol. 1, no. 2, pp. 81-87, Jun. 1997.
16. A.E. Eiben. R.Hinterding, and Z. Michalewicz, "Parameter control in evolutionary algorithms" *IEEE Trans. Evolut. Comput. Vol. 3. No.2*, pp, 124-141, Jul. 1999.
17. R.Storn and K.V. Price, "Differential evolution -A simple and efficient heuristic for global optimization over continuous Space," *J. Global Optim*, vol. 11, pp. 341-359. 1997.
18. K. Price, R. Storn and j. Lampinen, *Differential evolution-A Practical Approach to Global Optimization*. Berlin, Germany. Springer Verlag, 2005.

19. V. Feoktistov, *Differential Evolution: In Search of Solutions*. Berlin, Germany : Springer-Verlag, 2006.
20. J. Ilonen, J.-K. Kamarainen, and J. Lampinen, "Differential evolution training algorithm for feed-forward neural networks," *Neural Process Lett.*, vol. 7, no.1, pp. 93-105, 2003.
21. B.R. Andersen, P.J. Horton and P. Cartwright, "Topologies for VSC transmission," *Power Eng. J.*, vol. 16 pp. 142-150, Jun. 2002.
22. F. A.R Al Jowder and B. T. Ooi, "HVDC LIGHT station with SSSC characteristics," *IEEE Trans. Power Electron.* Vol. 19 no.4 pp. 1053-1059, Jun. 2004.
23. G. Asplund, "Application of HVDC light to power system enhancement," in *Proc. IEEE Power Eng. Soc. Winter Meeting*, Jan. 2000 vol. 4, pp. 2498-2503.
24. G. Zhang and Z. Xu, "Steady-state model for VSC based HVDC system and its controller design," in *Proc. IEEE Power Eng. Soc. Winter Meeting. Jan/Feb.2001*, vol 3, pp. 1085-1090.
25. G.B. Zhang, Zecel and G.Z. Wang, "Steady state model and its non linear control of VSC HVDC system" *Proc. CSEE*, vol. 22, pt. 1. Pp. 17-22, 2002.
26. M. Durrant, H. Werner, and K. Abbott, "Syntheses of multi-objective controllers for a VSC HVDC terminal using LMIs, in *Proc. IEEE Conf. Decision and Control*, Dec. 2004, pp. 4473-4478.
27. S.Y. Ruan, G.J.Li, X.H. Jiao, Y.Z. Sun and T.T. Lie, "Adaptive control design for VSC-HVDC system based on backstepping approach," *Elect. Power Syst. Res.*, vol. 77, no. 5-6, pp. 559-565, Apr.2007.
28. D. Aravindan, G.S. Ilango, C. Nagamani and A.V. S.S.R. Sai., "Power oscillation damping using UPFC in automatic power flow control mode with constant power reference", in *Proc. Int. Conf. Power and Energy system*, Baltimore, MD, Apr. 16-18, 2008, pp. 144-149.
29. H. Ebrahimirad, S. Vaez-Zadesh, and M. Jalili Kharaajoo, "Robust sliding mode control applied to speed control of PM synchronous motors, " in *Proc. Int. Symop. Circuits and systems. Jul. 10-11, 2003*.vol. 1, pp. 317-320.
30. Q.Zhou, F. Wang and L. Li, "Robust sliding mode control of 4 WS vehicles for automatic path tracking," in *Proc. IEEE intelligent Vehicles Symp. Jun. 6-8, 2005*, pp.819-826.