

January 2015

## Fault location using Sweep Frequency Response Analysis in Disc type transformer winding

Jineeth Joseph

*Division of High Voltage Engineering, Anna University Chennai, India, jineethjoseph@yahoo.com*

usha k

*Anna University, ushaeee@yahoo.co.in*

Usa. S.

*Division of High Voltage Engineering, Anna University Chennai, India, usau@gmail.com*

Follow this and additional works at: <https://www.interscience.in/ijeee>



Part of the [Power and Energy Commons](#)

---

### Recommended Citation

Joseph, Jineeth; k, usha; and S., Usa. (2015) "Fault location using Sweep Frequency Response Analysis in Disc type transformer winding," *International Journal of Electronics and Electrical Engineering*: Vol. 3 : Iss. 3 , Article 4.

Available at: <https://www.interscience.in/ijeee/vol3/iss3/4>

This Article is brought to you for free and open access by Interscience Research Network. It has been accepted for inclusion in International Journal of Electronics and Electrical Engineering by an authorized editor of Interscience Research Network. For more information, please contact [sritampatnaik@gmail.com](mailto:sritampatnaik@gmail.com).

# Fault location using Sweep Frequency Response Analysis in Disc type transformer winding

Jineeth Joseph  
Division of High Voltage Engineering  
Anna University Chennai,  
India  
jineethjoseph@yahoo.com

Usha K, Usa.S  
Division of High Voltage Engineering  
Anna University  
Chennai, India  
ushaeee@yahoo.co.in

**Abstract**—Winding faults are the leading cause of power transformer failures. Usually these failures develop in to more serious faults that would result in irreversible damage to the transformer winding and the consequential costs. This contribution is aimed at locating the faults by defining a set of two parameters based on change in impedance due to fault in the winding. Modeling and measurement of 22 kV continuous disc winding is done using circuit simulation package and sweep frequency response analyzer respectively.. The identified parameters are used in localization of faults in the transformer winding. The proposed method for localization of fault by measurement is validated by modeling

**Keywords**—Transformer Insulation, Faults, Modeling, SFRA

## I. INTRODUCTION

The power transformer plays a very important role in a power system. Damages to power transformer are unwelcome since the continuity in power delivery may be seriously disrupted. Furthermore repair or replacement is expensive and time consuming.[1] This insulation is mainly affected due to the over voltages caused by lightning and switching surges. In view of increasing demand for reliable and high quality energy supply, electrical utilities are more interested in avoiding transformer failures. However, degradation as a result of ageing under service conditions is inevitable

Deterioration of the insulation may be caused by a combination of electromechanical forces induced by a variety of factors. The chief factors are frequent transformer overloading, mechanical vibrations, high transient voltage stresses, high current stresses particularly in the presence of external short circuits, thermal overloading and contamination[2,6]. Early stages of winding faults may often have negligible effects on the transformer performance; however such faults may rapidly lead to more serious permanent forms such as phase to phase or phase to ground faults. Once the winding faults has occurred, a large circulating fault current is induced in the shorted portion, leading to localized thermal overloading in the defective region of the winding. Over some period of time, the generated heat in the defective region will cause the fault to increase in size, thereby increasing the fault energy level, until a catastrophic fault involving another phase or ground occurs. Accordingly it would be advantageous to detect faults in its earliest stage to prevent further damage to the transformer. Since transformers are one of the most important equipment in power networks, any efforts to increase their reliability, diagnosing and locating their faults would effectively reduce expenditures and transformer outage time.

Attempts to localize the faults in a transformer winding by analyzing the changes in inductance and capacitance have been observed in the literature [1]. Frequency response analysis as one of the well-recognized method for on-site diagnosis of power transformers is based on the fact that, each transformer winding has a unique signature of its transfer function. An attempt to localize the short circuit faults in a transformer winding by observing the impedance changes in sweep frequency response analysis (SFRA) has been presented in this paper

## II. IMPEDANCE CHARACTERISTICS OF FAULTY WINDING

Impedance of a transformer winding is subjected to changes during the occurrence of a fault [3]. Changes in the impedance of a winding can be studied by sweep frequency response analysis. This can be done using a sweep frequency response analyzer (SFRA).It essentially consists of

measuring the impedances of the transformer windings over a wide range of frequencies. Thus the impedance of the winding for a wide range of frequencies can be compared using sweep frequency response analyzer.

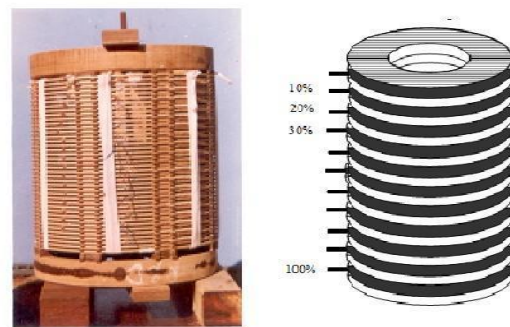


Fig 1. a) 22kV continuous disc winding  
b) Schematic diagram of the 22kV disc winding

SFRA is designed to detect winding displacements and faults in power transformers based on the comparison of their resonant frequencies with that of the frequencies corresponding to the healthy winding [4]. The system provides attenuation signature curves that can easily be compared for deviations which indicate core movements, winding faults, deformations and displacements, faulty core grounds and partial winding collapse etc. Sweep Frequency Response analysis on a 22 kV continuous disc model winding has been carried out. The model winding and its schematic diagram is shown in Figure. 1. This winding has 40 discs and each disc has 12 turns in it. The specifications are given in the appendix. Tapping's were brought out at every disc in order to create inter disc short fault. For instance, 10% and 5% fault is created by shorting 4 discs and 2 discs respectively.

### A. Measurement Setup

The measurement is done using FRAX (Meggar) and setup is shown in Fig.2. The impedance of the winding is measured under healthy condition and for various percentages of short circuits at different locations along the

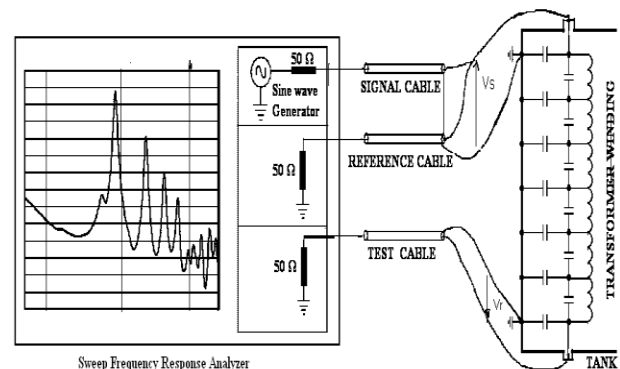


Figure 2. Experimental Set up [5]

winding. The short circuits are created by short circuiting the corresponding disks for each case .Short circuits of 5%,10%,25% and 50% at different locations along the winding are created and impedance is measured for each case.

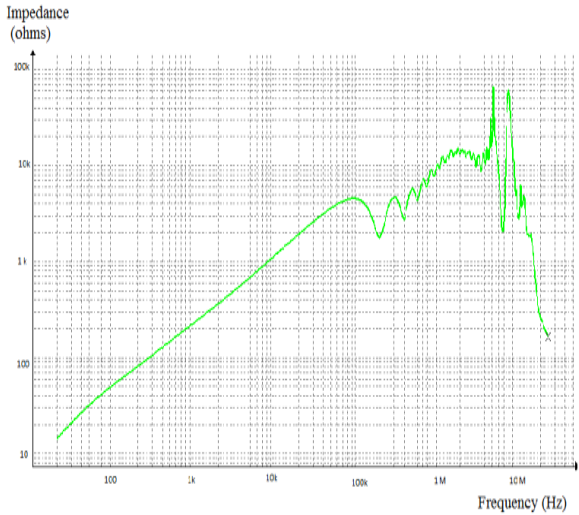


Figure 3a Impedance characteristics for healthy winding

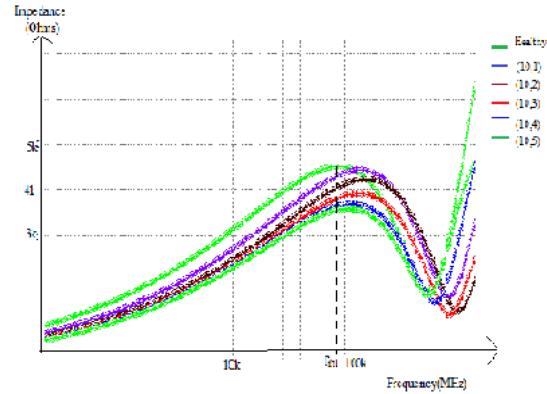


Figure 5b. Measured winding Impedance - characteristics for 10% faults in the winding

Figure 3 shows the impedance characteristics for healthy winding. It is observed that the impedance of the winding is comparatively small at lower frequencies and it increases gradually as the frequency is increased. Multiple resonances can be observed in the impedance. The measured impedance-characteristics for different fault cases of the winding is shown in Figure 3a. The impedance characteristics shows a definite variation with the percentage of fault. A shift in the resonant frequency is occurred depending on the location and percentage of fault. As the percentage of fault increases, the shift in the resonant frequency is increased. Change in impedance magnitude is also observed for each case. Figure 4 shows the dependence of impedance characteristics on the location of fault. The shift in resonant frequency and the corresponding magnitudes for 25% and 10% faults in the winding can be better observed in the Figures 5a and b respectively. The percentage of change in impedance is different for faults at different locations. Since considerable shift is observed in the first resonant frequency, compared with the higher order frequencies, only the impedance values corresponding to the first resonant frequency of winding for all fault cases is considered for analysis.

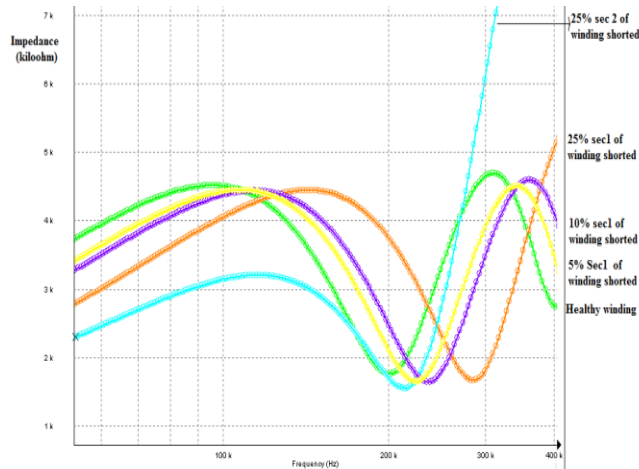


Figure 4 .Measured winding Impedance- characteristics for different faults

**B. Parameters for localization of fault**

The impedance characteristics of the healthy winding and the faulty winding are shown in Figure.6. The impedance of the healthy winding at its first resonant frequency is observed which is indicated as  $Z_a$ . The first resonant frequency of the healthy winding is  $f_a$  and that of the faulty winding is  $f_b$ . The magnitudes of the impedances at the first resonant frequency for faulty winding is indicated as  $Z_b$ . The impedance magnitudes for all the fault cases at the first resonant frequency of the healthy winding is denoted as  $Z_c$ .

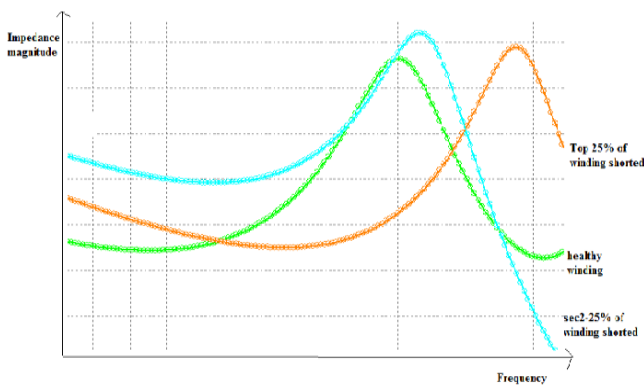


Figure 5a. Measured winding Impedance - characteristics for 25% faults in the winding

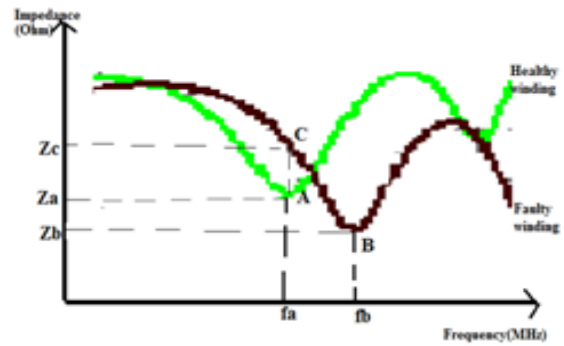


Fig.6 Impedance response of the healthy and faulty Winding at resonant frequency.

Two parameters can be defined based on the measured impedances at the resonant frequencies. These parameters can be defined as follows. Parameter-1 is indicated as  $Z_{ab}$  and parameter-2 is indicated as  $Z_{ac}$ , which are defined as follows.

$$Z_{ab} = (Z_a - Z_b) / Z_a * 100$$

$$Z_{ac} = (Z_a - Z_c) / Z_a * 100$$

$Z_{ab}$  indicates the percentage shift in impedance of the faulty winding at its first resonant frequency in compared with the impedance of the healthy winding at the first resonant frequency healthy winding.  $Z_{bc}$  indicates the shift in impedance of the winding at the first resonant frequency of healthy winding due to fault .

The calculated parameters  $Z_{ab}$  and  $Z_{ac}$  for each percentage of faults at different locations along the winding are given in Table 1a and 1b. These parameters show a considerable decrease in magnitude as the location of fault moves away from the centre of the winding, making it useful for localization of fault.

TABLE 1a. Parameters  $Z_{ab}$  and  $Z_{ac}$  for 5% faults

| Percentage and Location of fault | $Z_{ab}$ (%) | $Z_{ac}$ (%) |
|----------------------------------|--------------|--------------|
| 5-section 1                      | 1.44         | 2.54         |
| 5-section 2                      | 2.33         | 4.38         |
| 5-section 3                      | 4.34         | 6.6          |
| 5-section 4                      | 7.94         | 9.07         |
| 5-section 5                      | 9.71         | 11.13        |
| 5-section 6                      | 12.29        | 13.06        |
| 5-section 7                      | 13.94        | 14.59        |
| 5-section 8                      | 15.44        | 15.85        |
| 5-section 9                      | 16.31        | 16.64        |
| 5-section 10                     | 16.65        | 16.92        |
| 5-section 11                     | 16.46        | 16.74        |
| 5-section 12                     | 16.11        | 16.42        |
| 5-section 13                     | 15.18        | 15.62        |
| 5-section 14                     | 13.65        | 14.31        |
| 5-section 15                     | 11.94        | 12.71        |
| 5-section 16                     | 9.6          | 10.99        |
| 5-section 17                     | 7.07         | 8.93         |
| 5-section 18                     | 4.59         | 6.77         |
| 5-section 19                     | 2.73         | 4.62         |
| 5-section 20                     | 1.61         | 2.58         |

TABLE 1b. Parameters  $Z_{ab}$  and  $Z_{ac}$  for 25% and 10% faults

| Percentage and Location of fault | $Z_{ab}$ (%) | $Z_{ac}$ (%) |
|----------------------------------|--------------|--------------|
| 25-section 1                     | 1.45         | 12.03        |
| 25-section 2                     | 28.99        | 31.14        |
| 25-section 3                     | 28.63        | 30.86        |
| 25-section 4                     | 1.9          | 11.88        |
| 10-section 1                     | 1.7          | 4.09         |
| 10-section 2                     | 6.64         | 9.71         |
| 10-section 3                     | 13.1         | 15.01        |
| 10-section 4                     | 18.11        | 19           |
| 10-section 5                     | 20.6         | 21.06        |
| 10-section 6                     | 17.75        | 20.86        |
| 10-section 7                     | 12.87        | 18.68        |
| 10-section 8                     | 5.8          | 14.78        |
| 10-section 9                     | 1.67         | 9.53         |
| 10-section 10                    | 1.44         | 3.99         |

Figure 7 shows the variation of  $Z_{ab}$  and  $Z_{ac}$  with the location of the fault for 5%, 10% and 25 % faults along the winding.. Here both the parameters show symmetry with respect to the centre of the winding. Similar is observed for 5% and 25% faults. Hence the faults which are symmetrical with respect to the centre of the winding cannot be identified using these parameters. Hence the derived parameters can only be used to locate the position of the fault from the centre of the winding.

C. Proposed Method for Localization of faults

The percentage of short circuit for a faulty winding can be determined from the percentage reduction in the impedance of the winding with respect to the impedance of the healthy winding at very low frequency. The percentage reduction in the impedance corresponds to the percentage of short circuit in the winding.

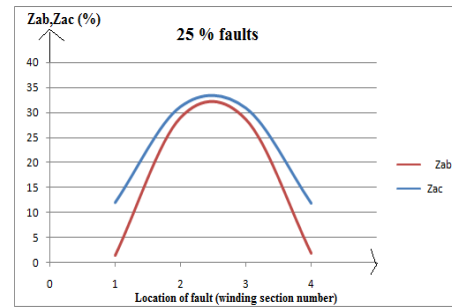
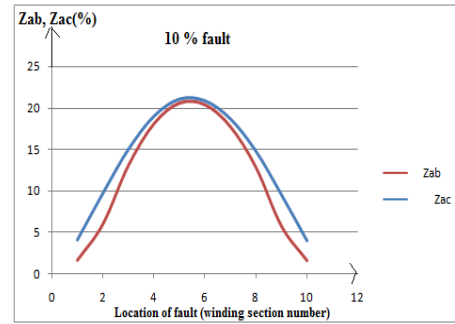
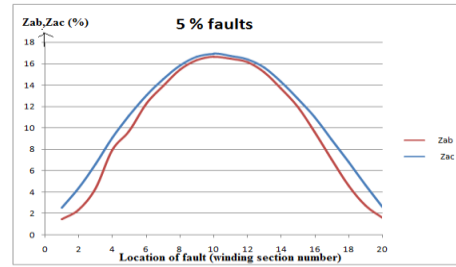


Figure 7.Parameters  $Z_{ab}$  and  $Z_{ac}$  (Vs) Location of fault for 5%, 10% and 25% faults

The calculated parameters for each fault condition yield a method to locate the fault. It is seen that there is a gradual decrease in the value of both the parameters  $Z_{ab}$  and  $Z_{ac}$ , when the location of fault moves away from the centre of the winding. The calculated parameters for each fault condition can be used as a reference value for each percentage of faults, which can be used to locate the fault. Given the frequency response of the faulty winding and comparing it with the impedance of the healthy winding, the parameters  $Z_{ab}$  and  $Z_{ac}$  can be computed. Thus by comparing the parameter values ( $Z_{ab}$  and  $Z_{ac}$ ) with the reference values for the corresponding percentage of short ,the location of short circuit fault from the centre of the winding can be determined.

III. SIMULATION OF 22 kV WINDING

A 22 kV continuous disc winding having 40 discs , each having 12 turns is modeled in circuit simulation package. The parameters of the winding such as inductance, shunt capacitance and series capacitance of the winding are computed using Finite Element Method (FEM) analysis and found to be 45mH, 467 pF, and 2.2 pF respectively. The lumped parameter model of 22 kV winding with 40 RLC sections is shown in Figure 8.The winding is simulated for healthy and faulty conditions for different locations of fault along the winding.

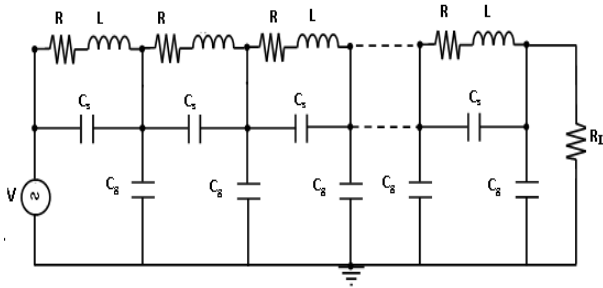


Figure 8. Lumped parameter model of the 22 kV disc winding

Due to symmetry, faults in only one half section of the winding are considered for simulation. The Pspice model of 22 kV winding is simulated for healthy and faulty conditions for different locations of fault with respect to the centre of the winding and the impedance characteristics of the model is obtained for each faulty condition. The parameter  $Z_{ab}$  and  $Z_{ac}$  is calculated for each case. The parameter values  $Z_{ab}$  and  $Z_{ac}$  with respect to location of fault within one half of the winding are shown in figure 9 and 10 respectively.

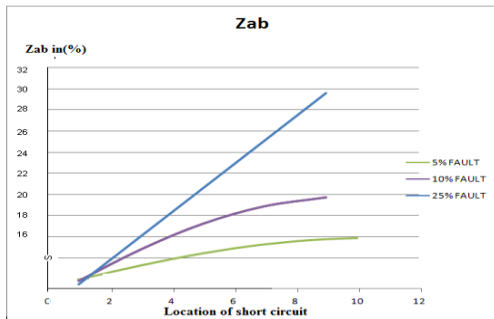


Figure 9. Parameter  $Z_{ab}$  (Vs) Location of short circuit for various percentage of faults

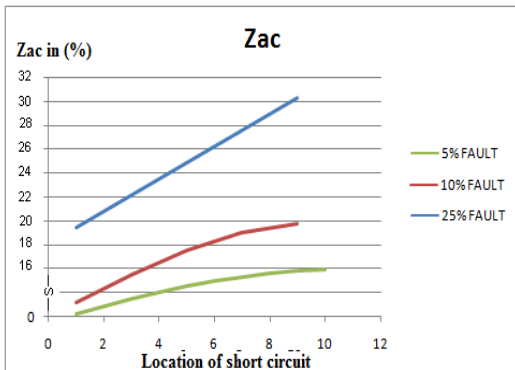


Figure 10. Parameter  $Z_{ac}$  (Vs) Location of short circuit for various percentage of faults

The derived parameters for each fault condition shows a gradual decrease in magnitude as the location of the fault moves away from the centre of the winding, for each percentage of faults. The parameter values by simulation shows a similar pattern when compared with those obtained by measurement. This clearly indicates the reliability of the proposed method to locate the fault based on the derived parameters.

#### IV. CONCLUSION

The two proposed parameters based on the changes in the impedance values at the resonant frequencies yields a method to locate the position of fault from the centre of the winding. The impedance response of the winding for short circuit faults at various locations along the winding by measurement on 22 kV winding shows considerable changes when the location of the fault changes. The analysis of the impedance characteristics of the winding by modelling also confirms the reliability and validity of the proposed parameters in locating the fault. Further studies are carried out in differentiating the faults occurring on either side with respect to the centre of the winding.

#### APPENDIX Specifications of Disc winding

|  |       |
|--|-------|
| Sections per coil  | 40    |
| Turns per sections   | 12    |
| Size of conductor  | 4.5*1 |
| Coil diameter (inner)  | 300   |
| Mean diameter  | 319.5 |
| Coil diameter (outer)  | 339   |
| Height of section axial  | 313   |
| Depth of windings (radial)   | 19.5  |
| Axial and radial spacing   | 3     |
| Section clearance  | 3     |
| Core thickness   | 3     |
| Core height  | 313   |
| <b>G.I. sheet is placed inside the windings to act as a core and the core is earthed. All dimensions are in mm</b> |       |

#### REFERENCES

- [1] T.Leibfried, K.Feser, "Monitoring of power transformers using the transfer function method", IEEE Transactions on power delivery, vol.14, No.4, October 1999
- [2] Farzad Shalefar, M. Sanaye Pasand, "Studying effect of location and resistance of interturn faults on fault current in power transformers", IEEE, UPEC, pp-138-142, 2007G.
- [3] L.Satish, K.Ragavan "Localization of changes in a model winding based on terminal measurements: Experimental study", IEEE Transactions on power deliver, Vol.22, No.3, pp-1557-1565, 2007
- [4] FRAX user manual version 2.3 "2009".
- [5] Prameela M, "Experimental Investigations to Identify SFRA Measurement Sensitivity for Detecting Faults in transformers" 16th national power systems conference, 15th-17th december, 2010.
- [6] Mohsen Fari, Mohammad Kharezi, "Localization of turn to turn faults in transformr using artificial neural networks and winding transfer function" IEEE 2010
- [7] Jineeth Joseph, Usha.K, Usa.S "Localalization of faults using sweep frequency response analysis in transformer winding" Conference proceedings, International conference on electrical engineering and computer science (EECS), April 2013.